




Sidewalk Requirements

- Number three (3) rebar on 18 inches center, each way
- Full expansion joint every 15 feet wet scored on the 5 & 10 foot measurement
- A sand cushion of 1 inch of the bottom
- A one ¼ inch slope per foot, side to side
- A 5 foot wide sidewalk
- The top of the sidewalk will be 1 inch per foot higher than the top of the street curb
- Sidewalk to be doweled into any existing driveway or other side walk, with three dowels, 4 inches deep
- Sidewalk thickness will be a minimum of 3 ½ inches
- If an obstacle is in the path of the sidewalk, such as a power pole, a 15 foot sweep before and after this obstacle (30 foot total)
- The sidewalk will have a broom finish, and trolled on edges of all form boards and expansion joints
- The sidewalk will be installed on City Property, starting 2 feet from the property line (in most cases)

SIDE WALKS (Typical)

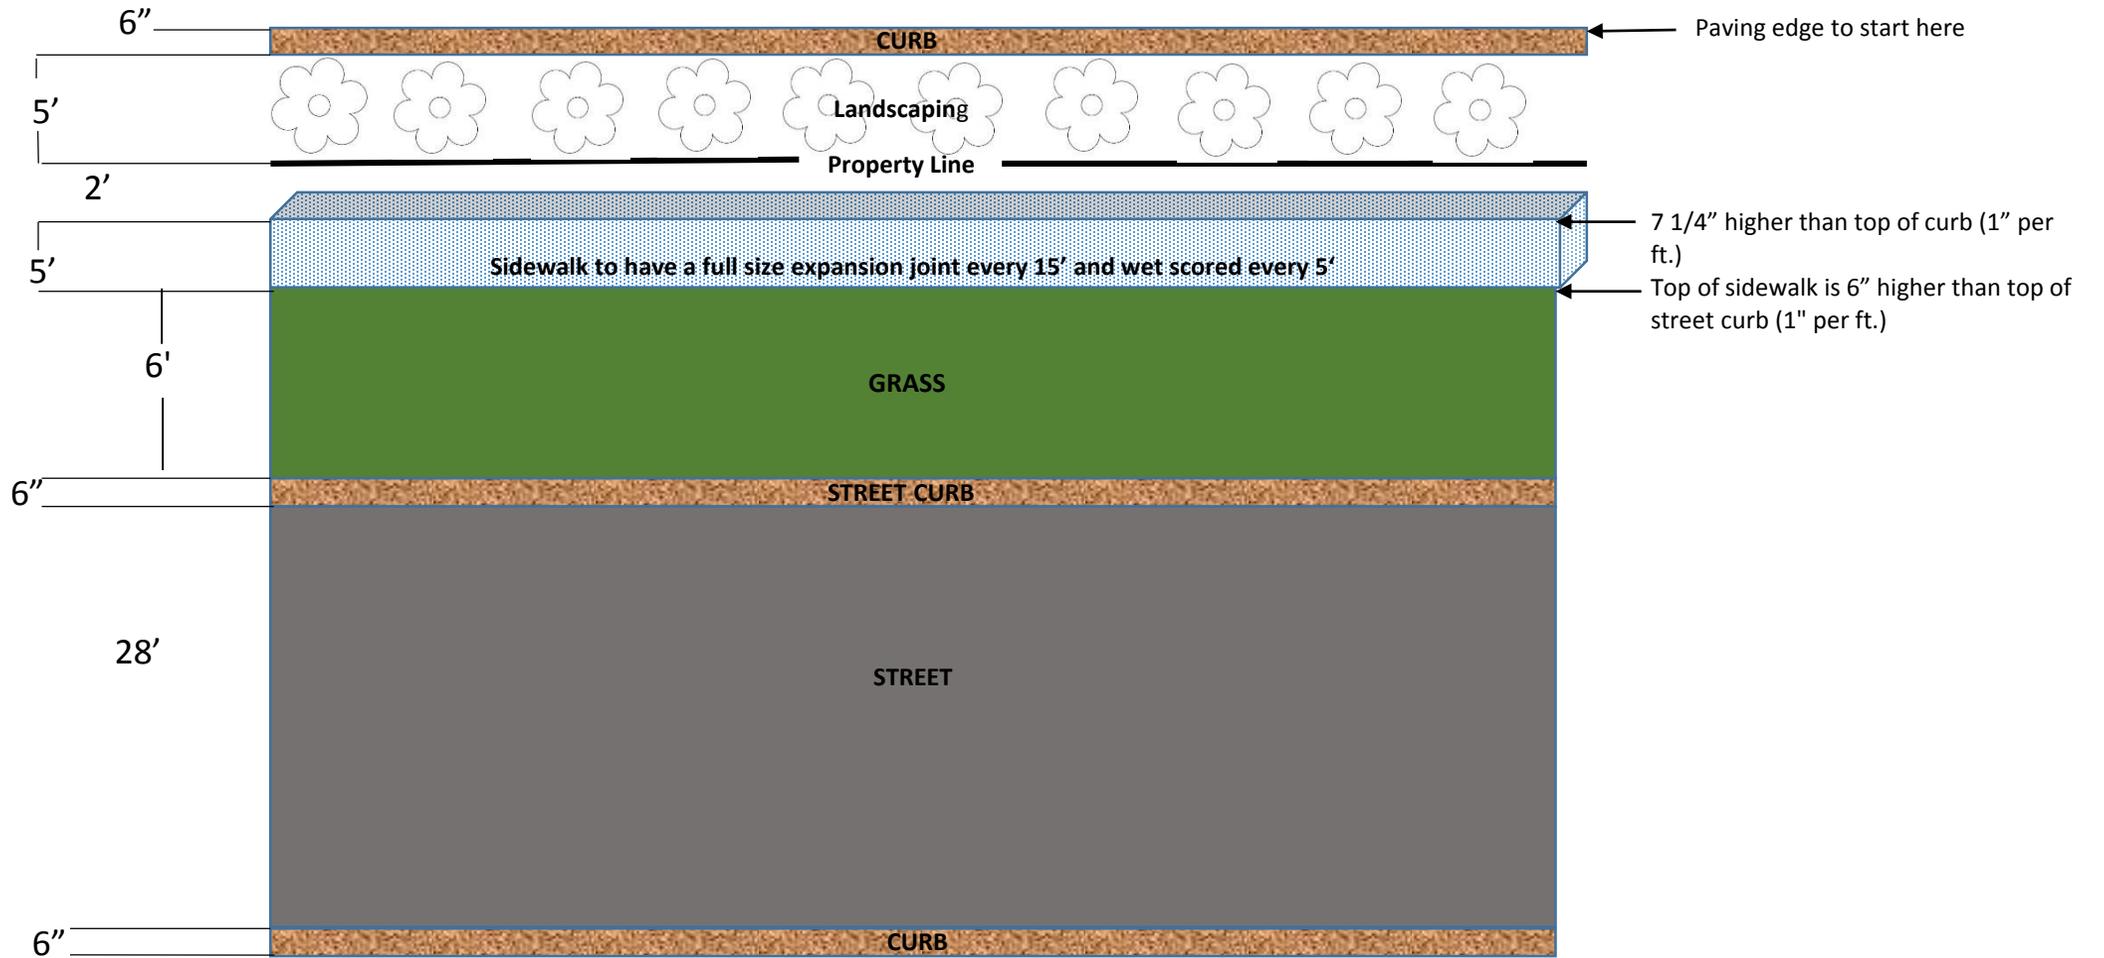

RESIDENTIAL/COMMERCIAL DRIVEWAY LAYOUT

